



5. Floor Gloss Test (광택도, 반사도)


Test Report

Device: LS190 GlossMeter SN: 190000383

Sample: #1 Test Date: 2025-11-13

Company: _____

Angle	Max	Min	Avg	Stdev	
60°	8.0	5.0	6.3	1.5	
	Lower limit	Upper limit	Total Test Points	Pass	NG
	0.0	10.0	3	3	0

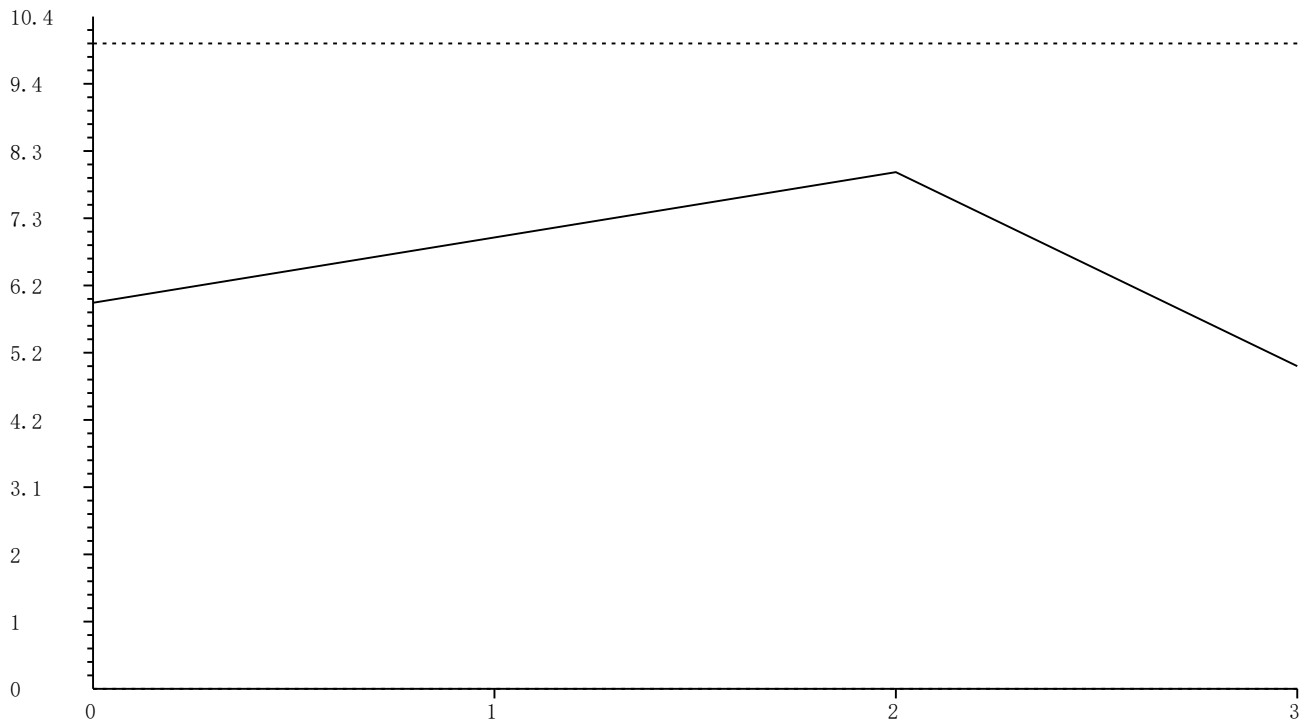

Tester:

Auditor:

SN	60°	Time
1	6.0	2025-11-13 10:12:09
2	8.0	2025-11-13 10:12:14
3	5.0	2025-11-13 10:12:26


Test Report

Device: LS190 GlossMeter SN: 190000383

Sample: #3 Test Date: 2025-11-13

Company: _____

Angle	Max	Min	Avg	Stdev	
60°	9.0	6.0	7.0	1.7	
	Lower limit	Upper limit	Total Test Points	Pass	NG
	0.0	10.0	3	3	0

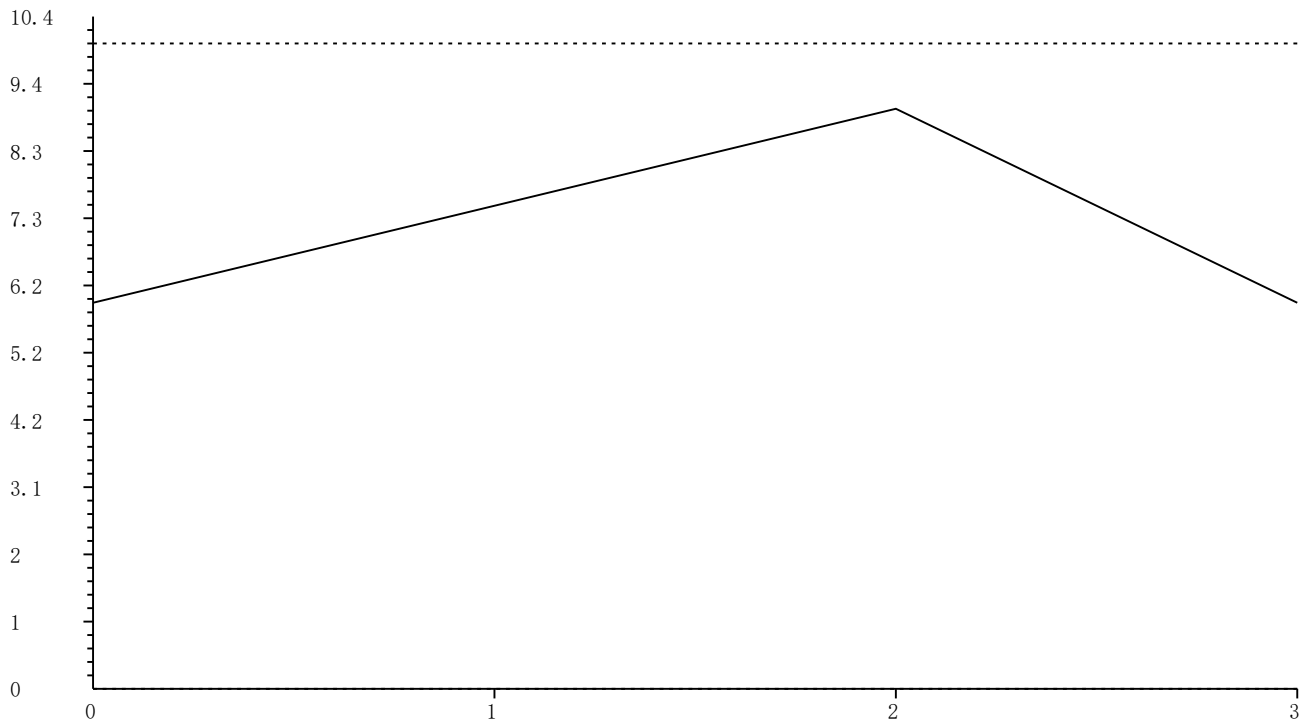

Tester:

Auditor:

SN	60°	Time
1	6.0	2025-11-13 16:20:14
2	9.0	2025-11-13 16:20:18
3	6.0	2025-11-13 16:20:21


Test Report

Device: LS190 GlossMeter SN: 190000383

Sample: #4 Test Date: 2025-11-13

Company: _____

Angle	Max	Min	Avg	Stdev	
60°	7.0	5.0	6.0	1.0	
	Lower limit	Upper limit	Total Test Points	Pass	NG
	0.0	10.0	3	3	0

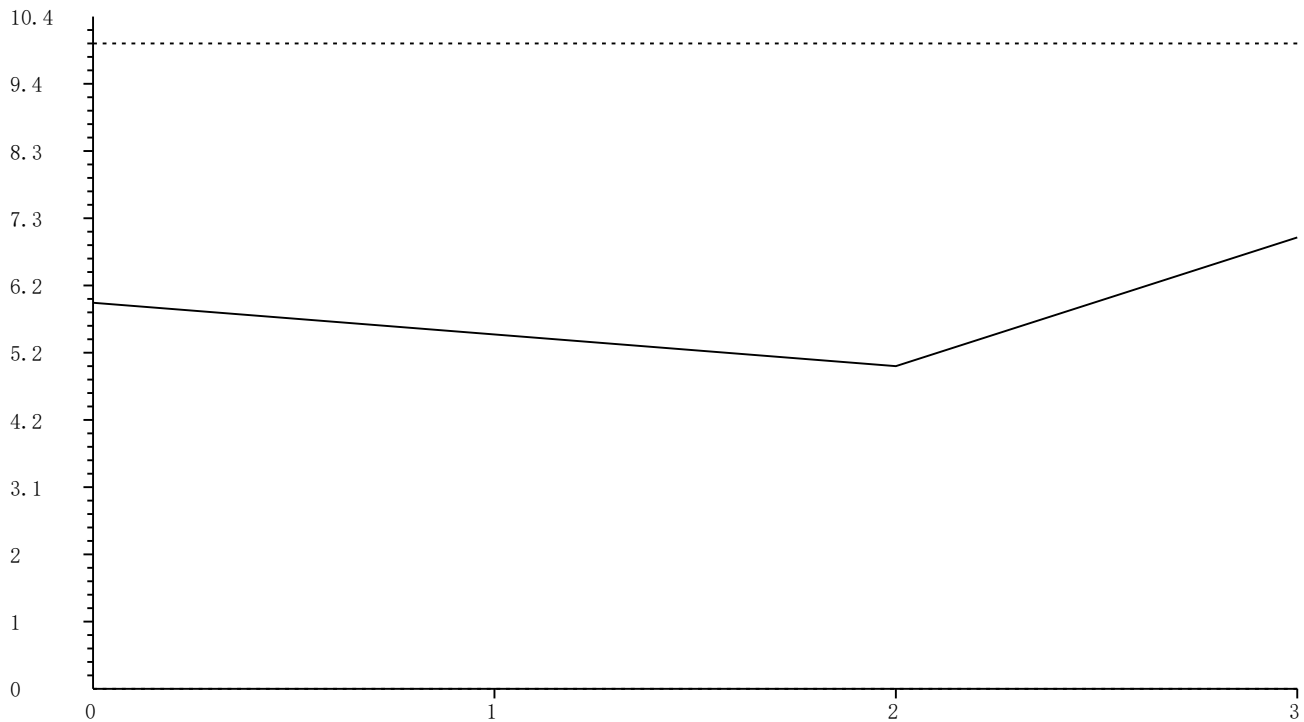

Tester:

Auditor:

SN	60°	Time
1	6.0	2025-11-13 16:23:16
2	5.0	2025-11-13 16:23:21
3	7.0	2025-11-13 16:23:24